

Electronic Exposed TECK® Flush Valve

TECK
COMMERCIAL

DELTA

❑ **81T201-WMSHWA**
Exposed Hardwire Operated
1-1/2" Top Inlet Closet Fixture

- Polished chrome-plated vandal resistant metal cover with 4" wallmount sensor
- Right or left-hand supply installation
- ADA compliant, automatic operation hardwire powered **H₂Optics®** technology infrared sensor
- Infrared sensor range adjustment of 610 mm - 1422 mm (24" - 56"), in 8" increments, factory set at 1,016 mm (40") [(± 50.8 mm (2"))]
- Hardwire adaptor
- Vandal resistant copper tube conduit
- 24 VAC input
- Electronic override button
- (110 to 24 VAC Transformer not included. See selection below for additional part number.)
- Quiet action, TECK® exposed diaphragm flush valve
- Chloramine resistant diaphragm
- Forged brass diaphragm retainer
- Renewable seat
- Polished chrome-plated body
- **External water conserving flush adjustment**, factory set to 6 litre (1.6 gal.) (except -48 and -6 models)
- **1" FIP/Copper sweat inlet adaptor**, angle check stop with protecting cap
- Adjustable 121mm (4-3/4") plus or minus 11mm (7/16") inlet/valve outlet centers
- Vacuum breaker
- Cover tube, stainless steel wall flange, spud flange, concealed spud nut, and 292 mm (11-1/2") outlet tube
- **Recommended water supply:**
Minimum flowing pressure – 25 psi (172 kPa)
Minimum flow rate – 25 gpm (95 L/min)

❑ **81T201-6-WMSHWA**
Same as 81T201-WMSHWA,
but **Not Field Adjustable**

❑ **81T201-48-WMSHWA**
Same as 81T201-WMSHWA,
but factory set to 4.8 litre (1.27 gal.),
Not Field Adjustable

❑ **81T201-42-WMSHWA**
Same as 81T201-WMSHWA,
but factory set to 4.2 litre (1.1 gal.),
Not Field Adjustable

- 4.2 Lpf (1.1 gpf) valve is recommended for new construction only



AVAILABLE OPTIONS FOR FIELD CONVERSION

❑ **061047A**
Hardwire with Battery Backup
See **DSP-BB** for detailed specification.

✓	TRANSFORMERS	
	060704A	110 to 24 VAC Class 2 20 VA (for up to 5 Electronic Valves)
	060771A	110 to 24 VAC Class 2 40 VA (for up to 10 Electronic Valves)

APPROVALS:

- IAPMO listed to ASSE 1037/ ASME A112.1037/CSA B125.37
- Indicates compliance to ICC/ANSI A117.1

(Contact Delta Representative for State and/or Local Approvals.)

Patented




Engineer/Architect Approval

Model Specified:

Approval:

Date:

81T201-WMSHWA

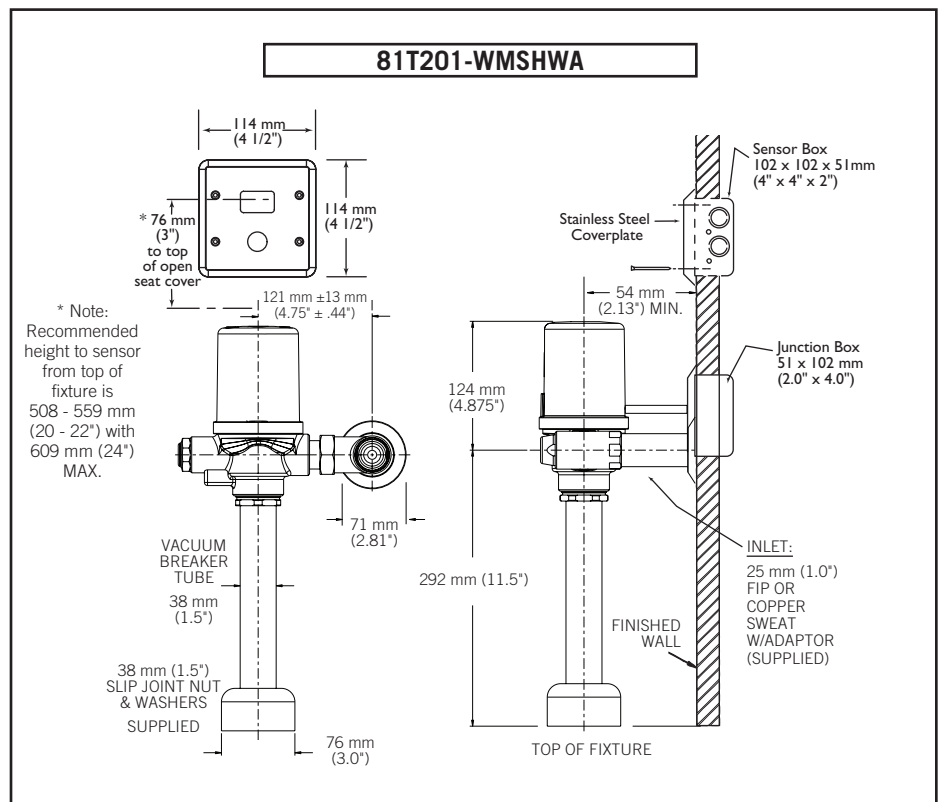

Note: For high and low pressure applications, please see page FEA-81T High Water Pressure note for more details.

Verify flow requirements with bowl manufacturer.

Note: Measurements may vary ± 6mm (0.25")

Refer to www.specselect.com for individual models.

Note: Use this page as a product submittal sheet.