


Broan Elite brings you Spire, an exciting new shape in a pro-style hood. It's high efficiency ensures energy savings while you enjoy pro-style performance.


SIZE	STAINLESS	GREASE FILTERS (replacement)	NON-DUCTED FILTERS
30-in.	SPE130SS	HPFA424 (Type "B5")	HPF24 (Type "Xb")
36-in.	SPE136SS	HPFA430 (Type "C5")	HPF30 (Type "Xc")

HVI PERFORMANCE									
Duct Orientation	Size	Damper	Sones			CFM			
			Normal	Medium*	High	Normal	Medium*	High 0.25 in. w.g.	High 0.1 in. w.g.
Vertical - Rectangular	3¼ in. x 10 in.	Included	<0.3*	3.0	8.0*	120*	270	410*	460*
Horizontal - Rectangular	3¼ in. x 10 in.	Included	<0.3*	3.0	7.5*	120*	290	470*	510*
Vertical - Rectangular	3¼ in. x 14 in.	Included	<0.3	3.0	8.0	150	300	470	520
Horizontal - Rectangular	3¼ in. x 14 in.	Included	<0.3	3.0	7.5	140	340	550	590
Round - Vertical	7 in.	Sold Separately	<0.3	3.0	8.0	140	280	415	470

FEATURES	
Max. Blower Airflow	650 CFM
Control type	3-speed Capacitive Touch
Delay off	no
Filter Clean Reminder	yes
Heat Sentry™	no
ADA Capable	yes
Lighting	2-level ENERGY STAR® LED (included)
Grease Filters	Hybrid Baffle (Qty. 2)
Installation Hardware	EZ1 Brackets
ENERGY STAR®	yes (no if installed non-ducted)
Recirculation	Non-ducted filters sold separately
3¼ in. x 10 in. Damper/ Duct Connector	included
AC INPUT	
120V, 60 Hz - 1.9 AMPS	
OPTIONAL ACCESSORIES	
7-in. Round Damper	BP87Q
ADA Wiring Kit	HAWRK3
Make-up Air Damper	MD6TU, MD8TU or MD10TU
MOUNTING HEIGHT	
24 in. to 30 in. from cooktop to bottom of hood	
LIMITED WARRANTY	
1-year	
3-year (LED modules only)	
(See installation manual for full warranty text.)	
FOR INDOOR USE ONLY	

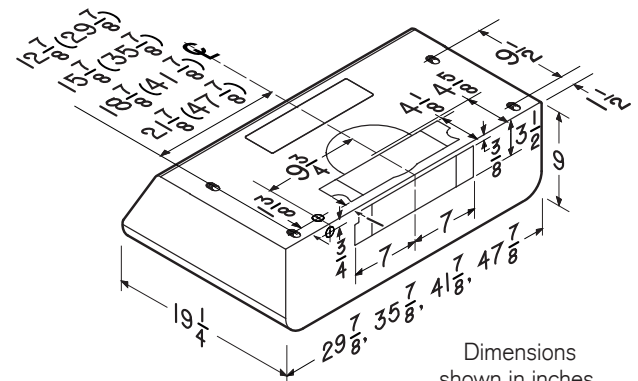

Dimensions shown in inches.

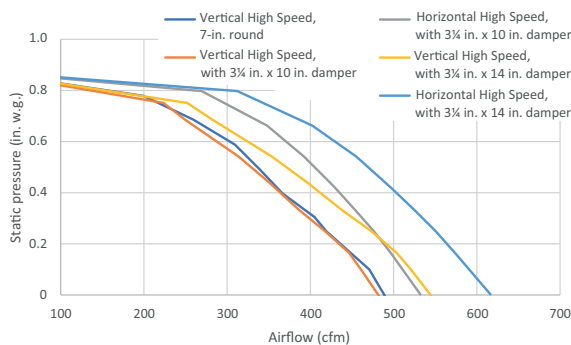

HVI-2100 CERTIFIED RATINGS comply with new testing technologies and procedures prescribed by the Home Ventilating Institute, for off-the-shelf products, as they are available to consumers. Product performance is rated at 0.1 in. static pressure, based on tests conducted in AMCA's state-of-the-art test laboratory. Sones are a measure of humanly-perceived loudness, based on laboratory measurements.

\* Where noted performance rating is not HVI certified but was established in accordance with HVI Standardized test procedure.