




Z415BL

BODY ASSEMBLY W/ "TYPE BL" STRAINER

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

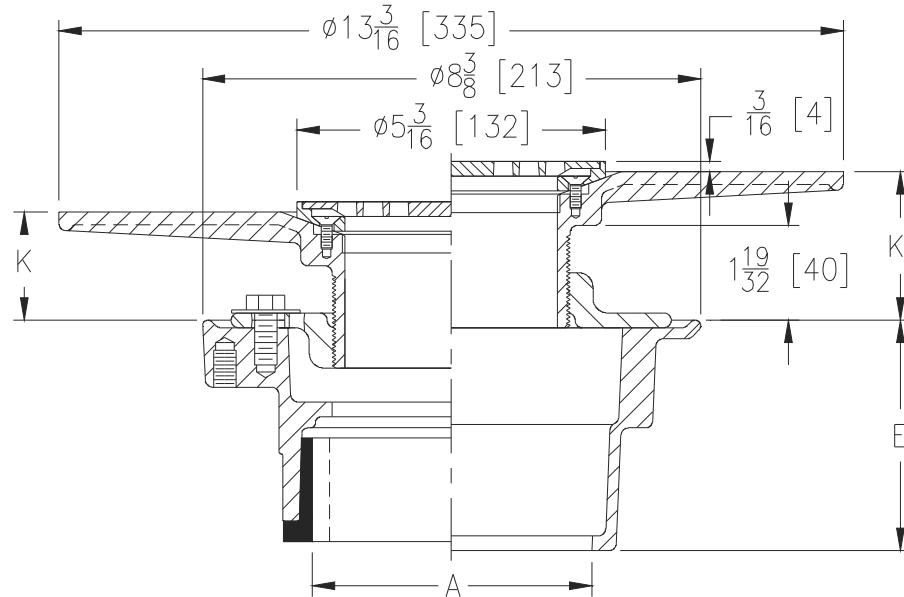

Strainer Designated	Dimensions in In [mm]					Approx. Wt. Lbs. [kg]	Strainer Open Area Sq. In. [cm ²]
	A - Pipe Size	K		K'			
		Min.	Max.	Min.	Max.		
-5BL	2,3,4,6 [51,76,102,152]	7/8 [22]	2-1/4 [57]	1-11/16 [43]	3 [76]	14 [6]	6-1/4 [40]

ENGINEERING SPECIFICATION: ZURNZN415BL

Floor and shower drain, Dura-Coated cast iron body with bottom outlet, combination invertible membrane clamp and adjustable collar with seepage slots and "TYPE BL" D.C.C.I. wide flanged head and polished nickel bronze, light-duty strainer.

OPTIONS (Check/specify appropriate options)

PIPE SIZE	(Specify size/type)	OUTLET	'E' BODY HT. DIM.
2,3,4 [51,76,102]	_____	IC Inside Caulk	3-7/8 [98]
2 [51]	_____	IP Threaded	2-3/8 [60]
3 [76]	_____	IP Threaded	2-5/8 [67]
4 [102]	_____	IP Threaded	2-7/8 [73]
6 [152]	_____	IP Threaded	2-3/4 [70]
2,3,4 [51,76,102]	_____	NH No-Hub	3-7/8 [98]
2,3,4 [51,76,102]	_____	NL Neo-Loc	3-3/4 [95]

PREFIXES

- _____ ZB D.C.C.I. Body Assembly w/ Polished Bronze Top
- _____ ZN D.C.C.I. Body Assembly w/ Polished Nickel Bronze Top*

SUFFIXES

- _____ -AR Acid Resisting Epoxy Coated Cast Iron
- _____ -CP Chrome-Plated Bronze Top
- _____ -G Galvanized Cast Iron
- _____ -P Trap Primer Connection (Specify 1/2 [13] or 3/4 [19])
- _____ -PC Protective Cover
- _____ -SA Stabilizer Assembly (See Z1035)
- _____ -TC Neo-Loc Test Cap Gasket (2,3,4 [51,76,102] NL Bottom Outlet Only)
- _____ -U 1 thru 3 [25 thru 76] High Extension Adapter
- _____ -VP Vandal-Proof Secured Top
- _____ -Y Sediment Bucket
- _____ -90 90° Threaded Side Outlet Body Assembly (2 [51], 3 [76] Only)

* Regularly furnished unless otherwise specified.